
CABLES

POLYCAB



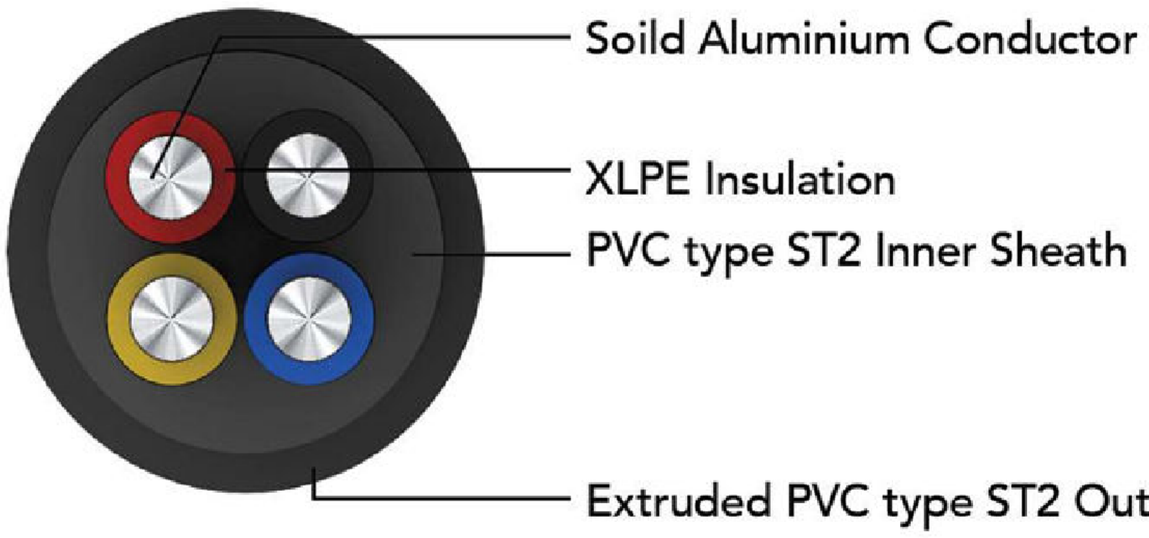

LT XLPE CABLE

TDS Doc.No:PIL/TE/250425/000006

DESIGN CODE : LVIS09AXUAY2004C2.5SA001S

Particulars		4 Core X 2.5 Sq.mm
Name of Manufacturer		Polycab India Ltd
Type of cable		A2XY
Voltage Grade V		1100
No of cores X size in sqmm		4 Core X 2.5 Sq.mm
Conductor		
a)	Material	H2/H4 Grade Aluminium as per Class 1 of IS: 8130/2013, latest
b)	Max. d.c. resistance of conductor at 20° C (ohm/km)	12.1000
c)	Shape of the conductor	Solid Circular
Insulation		
a)	Material	XLPE as per IS 7098(Pt-1)/88, Latest
b)	Nominal thickness (mm)	0.7
c)	Core identification	Red,Yellow,Blue,Black
Inner Sheath		
a)	Material	Extruded PVC Type ST2 as per IS:5831 / 84
b)	Minimum thickness (mm)	0.3
Armouring		Not Applicable
Outer Sheath		
a)	Material	Extruded PVC Type 'ST2' as per IS:5831/ 84
b)	Thickness (mm)	1.8 (Nom.)
c)	Colour of sheath	Black
Electrical Parameters		
a)	Max. a.c. resistance of conductor at 90° C (ohm/km)	15.5
b)	Calculated Cable reactance (ohm/km)	0.0981
c)	Impedance of cable (ohm/km)	15.5
Maximum conductor temperature under normal operating conditions		90°C
Maximum conductor temperature at the termination of short circuit		250°C

Format ID: TE/QMS/F/07, R-00, Date: 16/03/2025

Short Circuit rating of conductor for the duration of 1 sec (kA)	0.24
Continuous Current carrying capacities :-	
(a) In Ground at 30°C (A)	27
(b) In Air at 40°C (A)	24
Applicable Standard	IS 7098 Part I/88,IS 8130/2013,IS 5831/84, IS 3975/1999 etc. with latest up to date amendments
Approx. overall diameter of the cable in mm	12.5 +/- 2.0
Minimum bending radius	12 times Overall diameter
Max. Tensile strength	
(i) for Cables pulled with stocking (Newtons)	5 x D^2, D is the cable OD in mm
(ii) for Cables pulled with pulling eyes (N)	300
Embossing	POLYCAB ELECTRIC 1100 VOLTS GRADE XLPE
Printing	YEAR POLYCAB ELECTRIC 1100 VOLTS GRADE XLPE CABLE SIZE CABLE TYPE WITH SEQUENTIAL MARKING at every one meter interval.
Standard Drum Length (Mtr.)	1000 Mtr. ±5%
Non- Standard Drum Length (Mtr.)	Maximum 5% of order quantity

Note:-The values given above are subject to tolerances as per the relevant standards